



1170 PACIFIC STREET
SAN LUIS OBISPO, CA 93401
PH. 805.786.4802 FX. 805.786.4817

PROJECT:	HELIODYNE RACK		
JOB NO:	2008-36	SHEET:	1 OF 17
DESIGNED BY:	WCM	DATE:	1/22/2011
CHECKED BY:	KTD	DATE:	1/22/2011
SCOPE:	Racking Calculation Report		

STRUCTURAL CALCULATIONS

for

HELIODYNE SOLAR COLLECTOR RACK STRUCTURES

GOBI 406 AT 35 DEGREES

FOR HELIODYNE, INC.





Table of Contents

1. Summary of Results	1
2. Wind Loading Discussion	2
3. Analysis Model	3
4. Wind Loading Details	4
5. Clip/Rail/Mounting Foot Capacity Summary	5
6. Clip/Rail/Mounting Foot Wind Analysis Results	6
7. Leg & Anchorage Wind Analysis Results	7
8. Combined Wind and Snow Loading Discussion	8
9. Combined Wind and Snow Loading Details	9
10. Clip/Rail/Mounting Foot Snow + Wind Analysis Results	10
11. Combined Wind and Snow Loading Analysis Results	11
12. Seismic Loading & Combined Seismic & Snow Discussion	13
13. Seismic Loading & Analysis	14



Heliodyne Rack Structure with Gobi 406 Collector at 35 degrees - Summary of Results:

The following analysis and design are based on the 2009 International Building Code (IBC) and referenced standards:

- ASCE Minimum Design Loads for Buildings and Other Structures (ASCE7-05)
- 2005 National Design Specification for Wood Construction (NDS)
- 2005 Aluminum Design Manual (ADM)

The analysis includes load effects on the structure from the collector due to gravity loads, wind loads, snow loads and seismic loads. The results, presented in Table 1, represent the capacity of the rack structure for three combinations of site specific conditions (Conditions 1-3) with the following stipulations:

- One rack is provided on each of the long sides of the collector, i.e. racks spaced at 4' max.
- The strength of the collectors is beyond the scope of this report.
- The Engineer of Record for each specific installation shall be responsible for analyzing the design forces on the unit at that location and verifying that they are within the limits shown in Table 1.
- The Engineer of Record for each specific installation shall be responsible for the design of fasteners from the pedestal foot to the structure. Design for fasteners has been included, however due to the limitless possibilities of site conditions, only one design has been provided, and all conditions shown must be met for the design to be valid.
- The Engineer of Record for each specific installation shall be responsible for resolving the reactions into the structure to which the collector rack will be attached.
- Atmospheric Ice loading and flood loading are beyond the scope of this report.
- The rack structure analyzed in this report is defined in a drawing package prepared by Heliodyne, Inc, titled, *Heliodyne Rack Installation Guide*, dated 12/15/2010.

Based on the calculations that follow, the Heliodyne rack structure with a Gobi 406 collector angled at 35 degrees is capable of withstanding the demands prescribed by the IBC for the following site specific conditions:

Table 1. Summary of allowable site conditions for Gobi 406 at 35 degrees

Site Condition	Wind Load Variable ⁽¹⁾	Snow Load Variable ⁽²⁾	Seismic Load Variable ⁽³⁾⁽⁴⁾
	Maximum q_h (psf)	Maximum Total Snow Pressure (including drift) (psf)	Maximum S_{DS}
Condition 1	18.3	0	2.6
Condition 2	18.3	26.2	2.4
Condition 3	9.7	31.0	2.2

(1) q_h is determined from ASCE 7-05 Section 6.5.10.

(2) Maximum Total Snow Pressure is P_f (determined from ASCE 7-05 Section 7.3.) plus the effects of drift (from ASCE 7-05 Section 7.7).

(3) Where P_f is less than 30 psf, the S_{DS} from Condition 1 may be used.

(4) S_{DS} is determined from ASCE 7-05 Section 11.4.4.

In all conditions listed in Table 1, (2) 3/8" diameter lag bolts with a minimum 3" effective thread length (not including tapered end) into a Douglas Fir-Larch (N) member is sufficient provided the edge distance is greater than 1-1/2" and the end distance is greater than 2-5/8", both measured from the centerline of the lag bolt.



Wind Loading Only

Wind loads on collectors are limited by maximum allowable normal pressure on the glass for each collector, as reported by Heliodyne or the maximum wind load that the rack system can transfer to the supporting structure.

Pressure is calculated as: $p_w = q_h GC_N = 0.00256 K_z K_{zt} K_d V^2 I (GC_N)$

The rack structure was analyzed to determine a maximum factor q_h for each collector and angle of inclination. This variable allows all site specific variables to be included. The site specific variables are:

- Basic wind speed: V
- Velocity pressure exposure coefficient, evaluated at height z : K_z
- Topographic factor: K_{zt}

Variables for determining wind load that are not site specific are:

- Wind directionality factor: $K_d = 0.85$.
- Importance factor for wind: $I = 1.0$ (Unless Engineer of Record determines otherwise).
- Gust effect factor: $G = 0.85$.

The net pressure coefficient C_N is determined as an open building using ASCE 7 Monosloped Roof per Figure 6-18A and varies with angle of inclination. All pertinent data is included on each wind loading sheet. The load combinations with 1.2DL and DL include the full weight of collector, while cases with 0.9DL and 0.6DL use only the empty weight. The wind cases per ASCE 7-05 Figure 6-18A and the loading sheets to follow are represented in the load combinations as: W1= Case 1-A, W2 = Case 1-B, W3 = Case 2-A and W4 = Case 2-B. See Table 2.3.

Load Combinations:

Strength Level Combinations for aluminum member design per IBC 1605.2.1:

D1.	1.2DL + 1.6W1	D5.	1.2DL + 1.6W3
D2.	0.9DL + 1.6W1	D6.	0.9DL + 1.6W3
D3.	1.2DL + 1.6W2	D7.	1.2DL + 1.6W4
D4.	0.9DL + 1.6W2	D8.	0.9DL + 1.6W4

Allowable Stress Combinations for anchorage design per IBC 1605.3.1

S1.	DL + W1	S5.	DL + W3
S2.	0.6DL + W1	S6.	0.6DL + W3
S3.	DL + W2	S7.	DL + W4
S4.	0.6DL + W2	S8.	0.6DL + W4

Code Analysis Model for Wind

A 2-d frame model was created to analyze the distribution of forces to the rack. Reactions and member forces were calculated for all load combinations. The reactions at the base of the collector are transferred to the legs through the clip, rail and rail mounting foot. Forces in the legs and reactions at the feet were determined from the model.

The reactions at the rear leg are purely axial due to the relative stiffness between the front and rear leg; the front leg takes all of the lateral load. To determine the adequacy of the clip/rail/mounting foot assembly to transfer the forces from the collector to the legs a Solidworks FEM model was created. Loads were applied to the model and adjusted to a force level that corresponds to a factored limit state stress (FLSS) per Aluminum Design Manual (ADM 2005). The rear leg connection reactions were compared to loads corresponding to the FLSS for a tension case and a compression case. The angles at which the reactions in the front leg are resolved vary on a case by case basis. To accommodate this, an array of loads corresponding to the FLSS was created. The reactions in the front leg connection were compared to the array.

Capacities of each leg were calculated according to ADM 2005. Forces in each leg from the analysis were tabulated and compared to the capacities according the interaction requirements of ADM 2005.

The reactions at the foot were tabulated to determine the corresponding anchorage demands. These reactions were compared with the allowable loads on a wood structural panel in compression and a 3/8" diameter lag screw with a 3" embedment in a Douglas Fir-Larch (N) member, SG = 0.49.

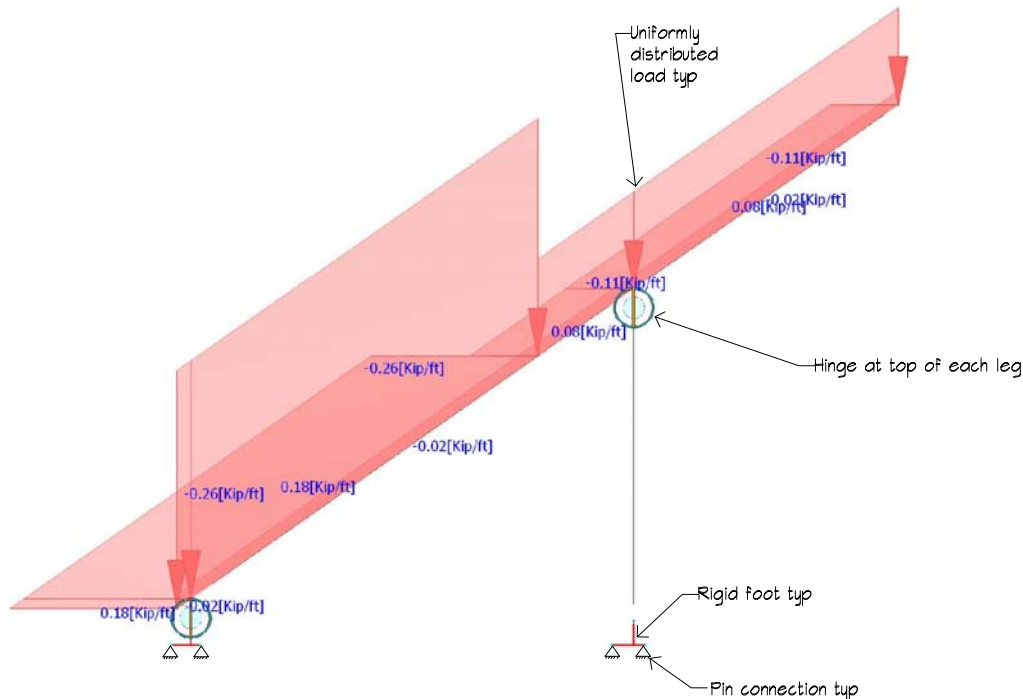


Figure 1. Typical Code Analysis Model

Summaries of capacities of the components follow. Tables 4.1-4.2, on page 6, show and compare the demand and capacity of the clip/rail/mounting foot assembly. Tables 5.1-5.3, on page 7, show and compare the demand and capacity of the rack's legs and fasteners, including interaction. Detailed calculations of FLSS and capacities can be found in the document "Heliodyne Rack Supplemental Calculations" available upon request to Heliodyne, Inc.

Wind Loading - Gobi 406 at 35 degrees

Building Type **Monosloped Roof** ASCE 7-05 Reference

Roof angle = **35** degrees

Frame Tributary **4.2** ft

$q_h(\text{design}) = 18.3$ psf (Based on rack component capacities)

Wind Pressure $p_w = q_h GC_N = 34.7$ psf max EQ 6-25

Table 2.1. Pressure Coefficient⁽¹⁾

	Case A	Case B
C_{NL1}	-1.8	-1.1
C_{NW1}	-1.5	-2.2
C_{NL2}	-0.9	0.2
C_{NW2}	0.7	1.8

(1) Linear interpolation used for Coefficient -
Minus sign indicates pressure acting away
from roof structure

Table 2.2. Net Design Wind Pressure (psf)⁽¹⁾


	Case A	Case B
P_{NL1}	-28.0	-17.1
P_{NW1}	-23.3	-34.7
P_{NL2}	-14.5	3.6
P_{NW2}	10.4	28.0

(1) Pressures shown correspond to coefficients
in Table 2.1


Table 2.3. Component Wind Pressure Over Tributary (plf)

	Case 1-A	Case 1-B	Case 2-A	Case 2-B
P_{XL}	-67.5	-41.2	25.0	67.5
P_{XH}	-56.2	-83.7	-35.0	8.7
P_{YL}	-96.3	-58.9	35.7	96.3
P_{YR}	-80.3	-119.5	-49.9	12.5

Figure 6-18A

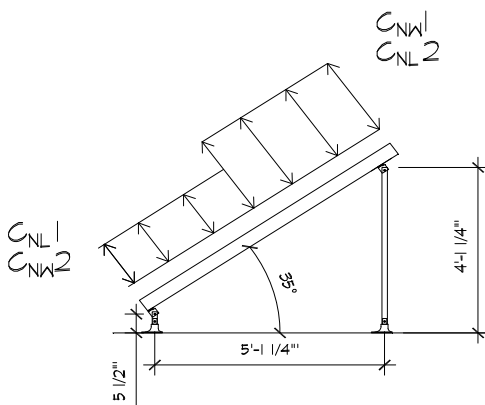

a) Pressure coefficients per ASCE
7-05 Figure 6-18A

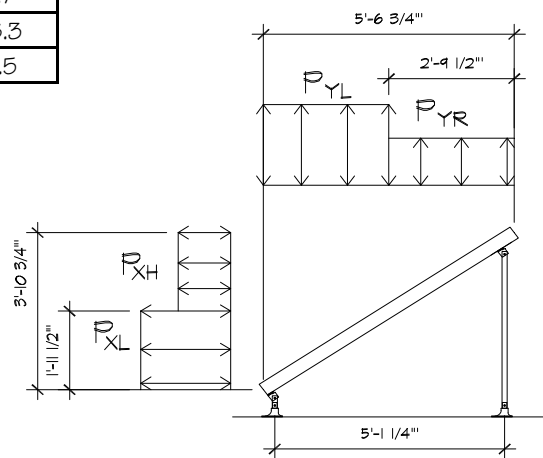

b) Corresponding collector wind pressures

Figure 2. Loading Diagrams

Clip/Rail/Mounting Foot Capacity Summary

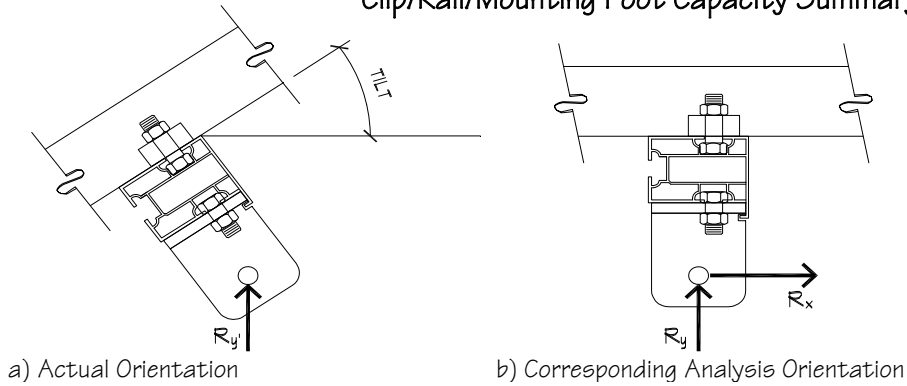


Figure 3. Rear Leg Assembly loading

Table 3.1. Rear Assembly Capacity

Tilt (degrees)	Load Direction	R_y (lb)	R_x (lb)	R_y (lb)
35	Tension	-630	-361	-516
35	Comp.	1274	731	1044
45	Tension	-571	-404	-404
45	Comp.	721	510	510

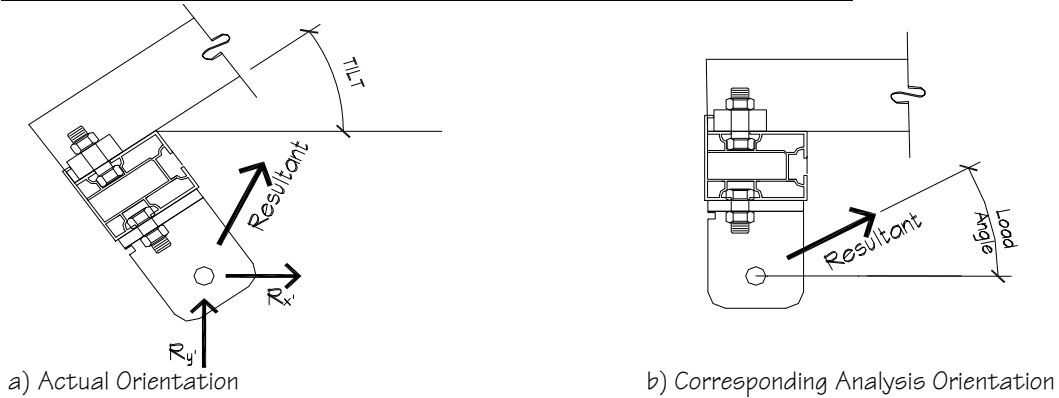


Figure 4. Front Leg Assembly loading

Table 3.2. Front Assembly Capacity

Load Angle	Resultant (lb)
0-40	600
40-85	690
85-95	1300
95-140	529
140-180	260
180-265	245
265-275	454
275-325	640
325-360	600

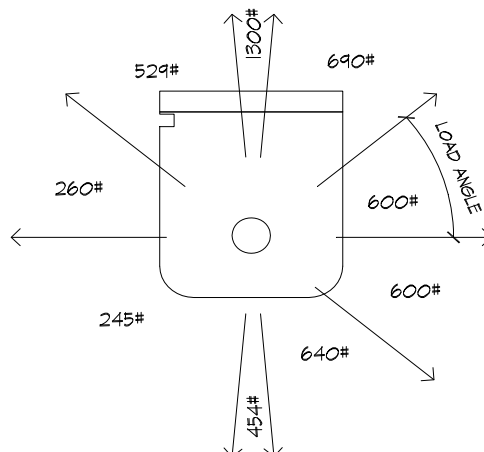


Figure 5. Front Assembly Capacity Array



Clip/Rail/Mounting Foot Analysis Results

Collector 406
Tilt 35 degrees
Loading Wind

Table 4.1. Rear Assembly Reactions

Load Case	R_x (lb)	R_y (lb)	Resultant (lb)	Load Angle (degrees)	Max Resultant (lb)	Resultant < Max?
D1	0	-461	461	235	630	YES
D2	0	-483	483	235	630	YES
D3	0	-600	600	235	630	YES
D4	0	-622	622	235	630	YES
D5	0	-122	122	235	630	YES
D6	0	-144	144	235	630	YES
D7	0	271	271	55	1274	YES
D8	0	249	249	55	1274	YES

Table 4.2. Front Assembly Reactions

Load Case	R_x (lb)	R_y (lb)	Resultant (lb)	Load Angle (degrees)	Max Resultant (lb)	Resultant < Max?
D1	385	-188	428	299	600	YES
D2	385	-208	437	297	600	YES
D3	394	-69	400	315	600	YES
D4	394	-89	404	312	600	YES
D5	37	181	184	43	690	YES
D6	37	161	165	42	690	YES
D7	-232	335	408	90	1300	YES
D8	-232	316	392	91	1300	YES



Heliodyne Rack Structure w/ Gobi 406
Collector @ 35 degrees

Collector 406 - 35 degrees
Member Front Leg
Loading Wind

$\phi M_n = 440 \text{ ft-}\#$
 $\phi V_n = 4600 \#$
 $\phi T_n = 15500 \#$
 $\phi C_n = 15500 \#$
 $\phi C_e = 599 \text{ k}$
 $C_m = 0.85$

Table 5.1. Front Leg Analysis Results

Load Combo	M_u (k-ft)	$\frac{M_u}{\phi M_n}$	V_u (k)	$\frac{V_u}{\phi V_n}$	T_u (k)	$\frac{T_u}{\phi T_n}$	C_u (k)	$\frac{C_u}{\phi C_n}$	Comb 1	Comb 2	Comb 3	Comb 4
D1	70	0.16	384	0.08	191	0.01	0	0.00	0.14	0.16	0.17	0.17
D2	70	0.16	384	0.08	212	0.01	0	0.00	0.14	0.16	0.17	0.17
D3	72	0.16	393	0.09	73	0.00	0	0.00	0.14	0.16	0.17	0.17
D4	72	0.16	393	0.09	93	0.01	0	0.00	0.14	0.16	0.17	0.17
D5	7	0.02	37	0.01	0	0.00	183	0.01	0.02	0.03	0.02	0.03
D6	7	0.02	37	0.01	0	0.00	163	0.01	0.02	0.03	0.02	0.03
D7	42	0.10	231	0.05	0	0.00	342	0.02	0.10	0.12	0.10	0.12
D8	42	0.10	231	0.05	0	0.00	322	0.02	0.10	0.12	0.10	0.12
Max Ratio =											0.17	

Collector 406 - 35 degrees
Member Rear Leg
Loading Wind

$\phi M_n = 440 \text{ ft-}\#$
 $\phi V_n = 4600 \#$
 $\phi T_n = 15500 \#$
 $\phi C_n = 6700 \#$
 $\phi C_e = 7.9 \text{ k}$
 $C_m = 0.85$

Table 5.2. Rear Leg Analysis Results

Load Combo	M_u (k-ft)	$\frac{M_u}{\phi M_n}$	V_u (k)	$\frac{V_u}{\phi V_n}$	T_u (k)	$\frac{T_u}{\phi T_n}$	C_u (k)	$\frac{C_u}{\phi C_n}$	Comb 1	Comb 2	Comb 3	Comb 4
D1	0	0.00	0	0.00	458	0.03	0	0.00	0.00	0.00	0.03	0.00
D2	0	0.00	0	0.00	479	0.03	0	0.00	0.00	0.00	0.03	0.00
D3	0	0.00	0	0.00	596	0.04	0	0.00	0.00	0.00	0.04	0.00
D4	0	0.00	0	0.00	617	0.04	0	0.00	0.00	0.00	0.04	0.00
D5	0	0.00	0	0.00	125	0.01	0	0.00	0.00	0.00	0.01	0.00
D6	0	0.00	0	0.00	146	0.01	0	0.00	0.00	0.00	0.01	0.00
D7	0	0.00	0	0.00	0	0.00	265	0.04	0.04	0.04	0.00	0.04
D8	0	0.00	0	0.00	0	0.00	244	0.04	0.04	0.04	0.00	0.04
Max Ratio =											0.04	

Table 5.3. ASD Wind Anchorage Demands

Load Combination	Front Foot					Rear Foot	
	T (K)	V (K)	Angle (deg)	z_α (#)	$z_\alpha < Z'\alpha?$	T (#)	$T < W'p?$
S1	368.2	120	72.0	387	YES	186	YES
S2	384.4	120	72.7	403	YES	203	YES
S3	325.9	123	69.4	348	YES	245	YES
S4	342.1	123	70.3	363	YES	262	YES
S5	0	11.7	0.0	11.7	YES	43	YES
S6	0	11.7	0.0	11.7	YES	60	YES
S7	103.5	-72.2	55.1	126	YES	0	YES
S8	111.6	-72.2	57.1	133	YES	0	YES



Combined Wind and Snow Loading

Snow loading, or a combination of snow and wind on collectors is limited by the maximum allowable normal pressure on the collector's glass or the maximum load that the racks can transfer to the supporting structure. Using the load combination of the IBC 1605.3.1 EQ 16-13, the maximum allowable snow pressure limited by the collector's glass is found by:

$$S = \left(\frac{\text{Allowable Pressure} - 0.75W}{0.75} \right) / \cos 35^\circ$$

Three cases for snow are used. The first case, S1, is a low baseline wind load corresponding to a structure at 15 feet above the ground, therefore maximizing the allowable snow load on the glass and racking. The second case, S2, is a wind load corresponding to roughly 85%-100% (100% if the q_{hmax} is low) of the maximum allowable wind load, as discussed in the previous section, and a corresponding snow load. Load combinations F1-F8 (below) correspond to S1 and E1-E8 to S2.

The allowable snow pressure on the collectors includes any effects of drift due to aerodynamic shade. Snow load, including drift, is to be determined on a site by site basis per Chapter 7 of ASCE 7-05 and any local provisions.

Load Combinations:

Strength Level Combinations for aluminum member design per IBC 1605.2.1:

F1	1.2DL + 1.6W1 + 0.5S1	E1	1.2DL + 1.6W1 + 0.5S2
F2	1.2DL + 0.8W1 + 1.6S1	E2	1.2DL + 0.8W1 + 1.6S2
F3	1.2DL + 1.6W2 + 0.5S1	E3	1.2DL + 1.6W2 + 0.5S2
F4	1.2DL + 0.8W2 + 1.6S1	E4	1.2DL + 0.8W2 + 1.6S2
F5	1.2DL + 1.6W2 + 0.5S1	E5	1.2DL + 1.6W2 + 0.5S2
F6	1.2DL + 0.8W2 + 1.6S1	E6	1.2DL + 0.8W2 + 1.6S2
F7	1.2DL + 1.6W2 + 0.5S1	E7	1.2DL + 1.6W2 + 0.5S2
F8	1.2DL + 0.8W2 + 1.6S1	E8	1.2DL + 0.8W2 + 1.6S2

Allowable Stress Combinations for anchorage design per IBC 1605.3.1

R1	DL + 0.75W1 + 0.75S2
R2	DL + 0.75W2 + 0.75S2
R3	DL + 0.75W3 + 0.75S2
R4	DL + 0.75W4 + 0.75S2

Code Analysis Model

The same model used for wind was utilized for analysis of the combination of wind and snow loading, see Figure 1. Loading variables are presented on the following page. Results from the code analysis model are shown and compared with component capacities on Tables 7.1 and 7.2 which follow.



Wind + Snow Loading - Gobi 406 at 35 degrees

Building Type	Monosloped Roof		6.5.13		
Snow Case	1	2			
Basic Wind Speed (mph)	85				
Wind Exposure	B				
Wind Pressure $p_w =$	$q_h G C_N$		EQ 6-25		
where $q_h = 0.00256 K_z K_{zt} K_d V^2 I =$	<table border="1"><tr><td>9.7</td><td>18.3</td></tr></table> psf		9.7	18.3	EQ 6-15
9.7	18.3				
	Snow Case	1	2		
	$K_z =$	0.62	Table 6-3		
	$K_d =$	0.85	Table 6-4		
	$K_{zt} =$	1	6.5.7.2		
	$G =$	0.85	6.5.8.1		
	$C_N =$	2.7	Figure 6-18A		
	$I =$	1	Table 6-1		

$$P_s \text{ max} = (\text{Max Glass Pressure} - 0.75 P_w) / 0.75$$

Table 6. Snow and Wind Loading (psf unless noted otherwise)

Snow Case	Maximum Collector Glass Pressure	Design q_h for Snow Case	P_w	P_s Max	Max Snow load per frame (plf)	Snow Load Per Frame Used in Design (plf)	P_s Used for Design
S1	75	9.7	22.4	90.3	462	130.0	31.0
S2	75	18.3	42.0	81.7	418	110.0	26.2



Clip/Rail/Mounting Foot Analysis Results

Collector 406
Tilt 35 degrees
Loading Wind + Snow

Table 7.1. Rear Assembly Reactions

Load Case	R _x (lb)	R _y (lb)	Resultant (lb)	Load Angle (degrees)	Max Resultant (lb)	Resultant < Max?
F1	0	99	99	55	1274	YES
F2	0	922	922	55	1274	YES
F3	0	26	26	55	1274	YES
F4	0	886	886	55	1274	YES
F5	0	279	279	55	1274	YES
F6	0	1012	1012	55	1274	YES
F7	0	487	487	55	1274	YES
F8	0	1116	1116	55	1274	YES
E1	0	-210	210	235	630	YES
E2	0	608	608	55	1274	YES
E3	0	-349	349	235	630	YES
E4	0	539	539	55	1274	YES
E5	0	129	129	55	1274	YES
E6	0	778	778	55	1274	YES
E7	0	522	522	55	1274	YES
E8	0	975	975	55	1274	YES

Table 7.2. Front Assembly Reactions

Load Case	R _x (lb)	R _y (lb)	Resultant (lb)	Load Angle (degrees)	Max Resultant (lb)	Resultant < Max?
F1	204	100	227	-9	600	YES
F2	102	541	550	44	690	YES
F3	209	163	265	3	600	YES
F4	104	572	582	45	690	YES
F5	20	295	296	51	690	YES
F6	10	638	638	54	690	YES
F7	-123	377	397	73	690	YES
F8	-61	679	682	60	690	YES
E1	385	-45	387	318	600	YES
E2	192	398	442	29	600	YES
E3	394	74	401	-24	600	YES
E4	197	457	498	32	600	YES
E5	37	324	327	48	690	YES
E6	19	582	583	53	690	YES
E7	-232	479	532	81	690	YES
E8	-116	660	670	65	690	YES



Collector 406 - 35 degrees
Member Front Leg
Loading Wind + Snow

$\phi M_n = 440$ ft-#
 $\phi V_n = 4600$ #
 $\phi T_n = 15500$ #
 $\phi C_n = 15500$ #

$\phi C_e = 599$ k
 $C_m = 0.85$

Table 8.1. Front Leg Analysis Results

Load Combo	M_u (k-ft)	$\underline{M_u}$ ϕM_n	V_u (k)	$\underline{V_u}$ ϕV_n	T_u (k)	$\underline{T_u}$ ϕT_n	C_u (k)	$\underline{C_u}$ ϕC_n	Comb 1	Comb 2	Comb 3	Comb 4
F1	37	0.08	204	0.04	0	0.00	85	0.01	0.08	0.09	0.08	0.09
F2	19	0.04	102	0.02	0	0.00	876	0.06	0.09	0.10	0.04	0.10
F3	38	0.09	209	0.05	0	0.00	12	0.00	0.07	0.09	0.09	0.09
F4	19	0.04	105	0.02	0	0.00	839	0.05	0.09	0.10	0.04	0.10
F5	4	0.01	20	0.00	0	0.00	262	0.02	0.02	0.03	0.01	0.03
F6	2	0.00	10	0.00	0	0.00	965	0.06	0.07	0.07	0.00	0.07
F7	22	0.05	122	0.03	0	0.00	468	0.03	0.07	0.08	0.05	0.08
F8	11	0.03	61	0.01	0	0.00	1068	0.07	0.09	0.09	0.03	0.09
E1	70	0.16	384	0.08	219	0.01	0	0.00	0.14	0.16	0.17	0.17
E2	35	0.08	193	0.04	0	0.00	572	0.04	0.10	0.12	0.08	0.12
E3	72	0.16	393	0.09	357	0.02	0	0.00	0.14	0.16	0.19	0.17
E4	36	0.08	197	0.04	0	0.00	503	0.03	0.10	0.11	0.08	0.12
E5	7	0.02	38	0.01	0	0.00	115	0.01	0.02	0.02	0.02	0.02
E6	3	0.01	19	0.00	0	0.00	739	0.05	0.05	0.06	0.01	0.06
E7	42	0.10	231	0.05	0	0.00	504	0.03	0.11	0.13	0.10	0.13
E8	21	0.05	116	0.03	0	0.00	934	0.06	0.10	0.11	0.05	0.11
Max Ratio =										0.19		



Collector 406 - 35 degrees

Member Rear Leg

Loading Wind + Snow

$\phi M_n = 440 \text{ ft-#}$

$\phi C_e = 7.9 \text{ k}$

$\phi V_n = 4600 \text{ #}$

$C_m = 0.85$

$\phi T_n = 15500 \text{ #}$

$\phi C_n = 6700 \text{ #}$

Table 8.2. Rear Leg Analysis Results

Load Combo	M_u (k-ft)	$\underline{M_u}$ ϕM_n	V_u (k)	$\underline{V_u}$ ϕV_n	T_u (k)	$\underline{T_u}$ ϕT_n	C_u (k)	$\underline{C_u}$ ϕC_n	Comb 1	Comb 2	Comb 3	Comb 4
F1	0	0	0	0	0	0	85	0.00	0.00	0.00	0.01	0.00
F2	0	0	0	0	0	0	876	0.04	0.04	0.04	0.00	0.04
F3	0	0	0	0	0	0	12	0.00	0.00	0.00	0.02	0.00
F4	0	0	0	0	0	0	839	0.03	0.03	0.03	0.00	0.03
F5	0	0	0	0	0	0	262	0.01	0.01	0.01	0.00	0.01
F6	0	0	0	0	0	0	965	0.05	0.05	0.05	0.00	0.05
F7	0	0	0	0	0	0	468	0.03	0.03	0.03	0.00	0.03
F8	0	0	0	0	0	0	1068	0.06	0.06	0.06	0.00	0.06
E1	0	0	0	0	219	0.01	0	0.00	0.00	0.00	0.01	0.00
E2	0	0	0	0	0	0.00	572	0.09	0.09	0.09	0.00	0.09
E3	0	0	0	0	357	0.02	0	0.00	0.00	0.00	0.02	0.00
E4	0	0	0	0	0	0.00	503	0.08	0.08	0.08	0.00	0.08
E5	0	0	0	0	0	0.00	115	0.02	0.02	0.02	0.00	0.02
E6	0	0	0	0	0	0.00	739	0.11	0.11	0.11	0.00	0.11
E7	0	0	0	0	0	0.00	504	0.08	0.08	0.08	0.00	0.08
E8	0	0	0	0	0	0.00	934	0.14	0.14	0.14	0.00	0.14
										Max Ratio =		0.14

Seismic Loading & Combined Seismic & Snow

Seismic Loading was determined using the provisions of ASCE 7-05 Chapter 13 Seismic Design Requirements for Nonstructural Components. The design force is found from equations 13.3-(1-3):

$$F_p = \frac{0.4a_p S_{DS} W_p}{\frac{R_p}{I_p}} \left(1 + 2 \frac{z}{h}\right)$$

$$0.3 S_{DS} I_p W_p < F_p \leq 1.6 S_{DS} I_p W_p$$

Where:

- S_{DS} = Spectral acceleration, short period, as determined from Section 11.4.4 – A maximum value of 1.55 was assumed.
- a_p = Component amplification factor from Table 13.6-1: 1.0 for “mechanical components constructed of highly deformable materials”.
- I_p = Component importance factor: 1.0.
- W_p = Component operating weight & effective weight of snow.
- R_p = Component response modification factor from Table 13.6-1: 2.5 for “mechanical components constructed of highly deformable materials”.
- z = Height in structure of point of attachment of component with respect to the base.
- h = Average roof height of structure with respect to the base – for roof mount collectors, $z/h = 1$.

$$F_p = 0.48 S_{DS} \quad \& \quad F_{p(asa)} = 0.336 S_{DS}$$

Seismic analysis was performed for the three snow cases. Per ASCE 7-05 section 12.7.2 where $P_f > 30$ psf, 20% of snow load is to be included in seismic weight. Where $P_f < 30$ psf snow load is not required to be included in seismic weight.

Wind loading on a light structure such as this will govern perpendicular to the face of the collector. In the direction parallel to the surface of the collector's seismic loading will govern design. A simple approach of statics was used to determine the demand on the legs of the rack structure. An allowable spectral acceleration, S_{DS} , has been determined for each of the three cases. The analysis is based on allowable compression perpendicular to grain for a Hem-Fir support and anchorage of a lag bolt discussed earlier.

Load Combinations:

Allowable Stress Combinations per IBC 1605.3.1

- | | |
|---|-------------------------|
| 1 | DL + 0.7E |
| 2 | DL + 0.75(0.7E) + 0.75S |

Longitudinal Seismic Loading

$$SF_y = 0 \rightarrow E = 2 \cdot R_y \rightarrow R_y = E/2$$

$$SM_A = 0 \rightarrow Ee = 4 \cdot R_x \rightarrow R_x = Ee/4$$

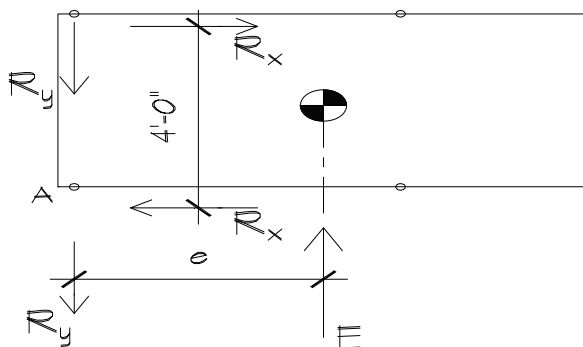


Figure 6. Seismic Loading

Table 9. Seismic Demand (ASD)

Snow Case	Snow per frame (plf)	S_{DS}	E Horiz (#)	e (ft)	R_y (#)	R_x (#)	$\Sigma M_0 = R_y \cdot 5.7''$
1	130	2.2	146	2.9	73	106	537
2	110	2.4	145	2.9	73	105	577
3	0	2.6	103	2.9	52	75	540

Table 10. Seismic Analysis Results ⁽¹⁾

Snow Case	D (#)	0.75* S (#)	σ_{vert} (psi) ⁽²⁾	$\Sigma M_R = F \cdot A$	$\Sigma M_R > \Sigma M_0 ?$	T_y (#)	V_y (#)	T_x (#)	V_x (#)	Angle (deg)	Z_a (#)
1	50	254	65.7	560	YES	80	73	63	53	58	169
2	50	215	57.3	587	YES	99	73	74	53	63	195
3	50	0	10.8	677	YES	144	52	95	37	75	247

(1) See following page for determination of stress at bottom of foot

(2) σ_{vert} is compressive stress due to dead and snow loads

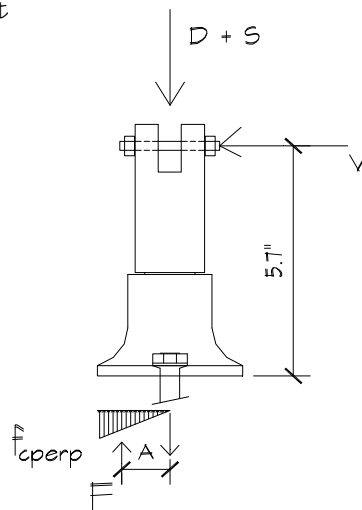


Figure 7. Seismic Loading on Foot

Table 11. Stresses on Foot - Seismic Overturning

Segment	area _x (in ²)	a _x (in)	f _{cperpx1} (psi)	f _{cperpx2} (psi)	f _{cperpx} ave (psi)	r _x (#)	f _{cperpx} ave (psi)	r _x (#)	f _{cperpx} ave (psi)	r _x (#)
1	0.076	1.6	294	276	285	21.7	293	22.3	338	25.7
2	0.145	1.5	276	258	267	38.7	275	39.9	318	46.1
3	0.201	1.4	258	240	249	50.1	257	51.7	297	59.7
4	0.253	1.3	240	222	231	58.4	239	60.5	276	69.8
5	0.277	1.2	222	204	213	58.9	221	61.3	255	70.7
6	0.256	1.1	204	186	195	49.8	203	52.0	234	60.0
7	0.27	1	186	168	177	47.7	185	50.0	213	57.6
8	0.293	0.9	168	149	158	46.4	167	48.9	193	56.4
9	0.316	0.8	149	131	140	44.4	149	47.1	172	54.3
10	0.33	0.7	131	113	122	40.3	131	43.2	151	49.8
11	0.34	0.6	113	95	104	35.4	113	38.4	130	44.3
12	0.348	0.5	95	77	86	29.9	95	33.0	109	38.1
13	0.355	0.4	77	59	68	24.1	77	27.2	89	31.4
14	0.355	0.3	59	41	50	17.7	59	20.8	68	24.0
15	0.328	0.2	41	23	32	10.4	41	13.3	47	15.4
16	0.289	0.1	23	5	14	3.9	23	6.5	26	7.5
17	0.074	0	5	0	2	0.2	5	0.3	5	0.4
						F (#) =	578			
						A (in) =	0.968			
						F (#) =	617			
						A (in) =	0.952			
						F (#) =	711			
						A (in) =	0.952			

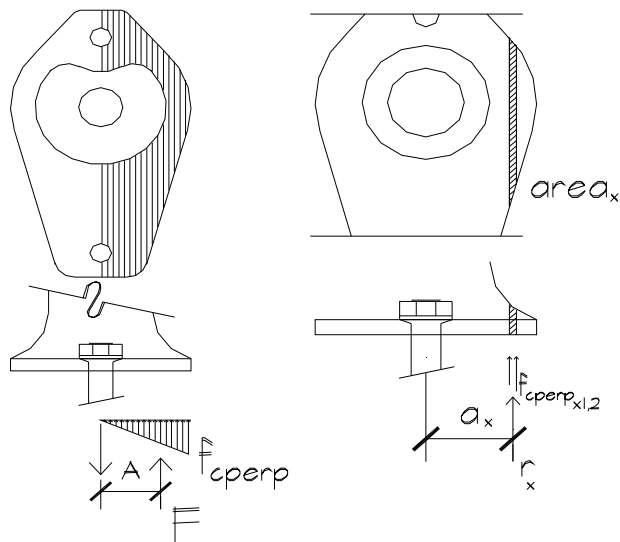


Figure 8. Stress Distribution @ Foot